


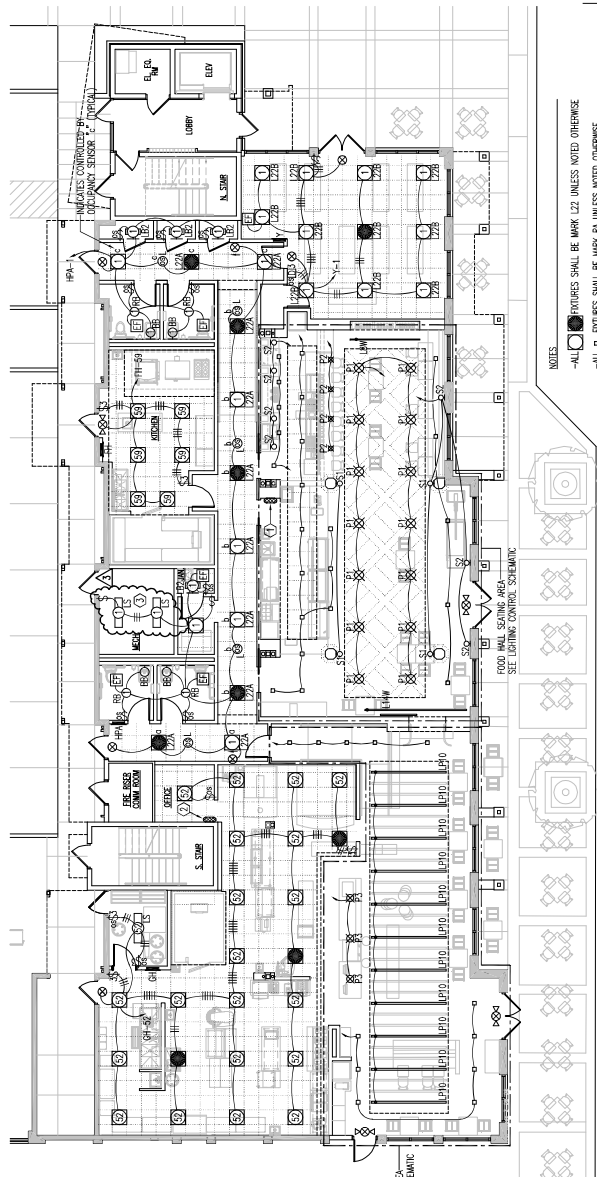

LIGHTING PLAN
SCALE: 1/8" = 1'-0"

NOTES


-ALL  FIXTURES SHALL BE MARK L22 UNLESS NOTED OTHERWISE

-ALL  FIXTURES SHALL BE MARK RA UNLESS NOTED OTHERWISE

-CONNECT EXIT LIGHTS TO LOCAL LIGHTING CIRCUITS AHEAD OF SWITCH.


KEY NOTES

- ① FOOD HALL DIMMER SWITCHES AND LIGHTING SWITCHES. SEE LIGHTING CONTROL SCHEMATIC.
- ② DIMMER SWITCHES AND SINGLE POLE SWITCHES SERVING GREAT HARVEST SEATING AREA LIGHTING. SEE LIGHTING CONTROL SCHEMATIC.
- ③ COORDINATE FINAL FIXTURE LOCATION WITH EQUIPMENT AND DUCT WORK.

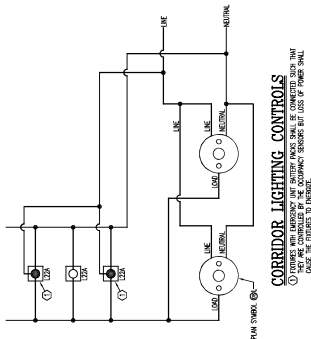

CORRIDOR LIGHTING CONTROLS

① FIXTURES WITH EMERGENCY UNIT BATTERY PACKS SHALL BE CONNECTED SUCH THAT THEY ARE CONTROLLED BY THE OCCUPANCY SENSORS BUT LOSS OF POWER SHALL CAUSE THE FIXTURES TO ENERGIZE.

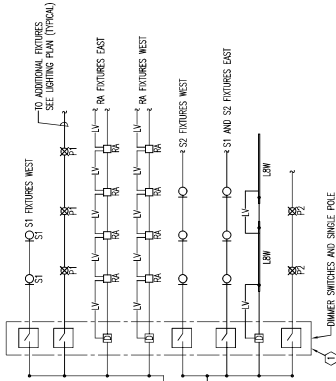

FOOD HALL LIGHTING SEATING AREA LIGHTING CONTROLS


GENERAL NOTES

(1) DIMMER SWITCH WITH 0-10V CONTROL LEGRAND RADIANt SERIES


(2) OCCUPANCY SENSOR DIMMER SWITCH WITH 0-10V CONTROL LEGRAND DW-311 SERIES

(3) SINGLE POLE LIGHTING SWITCH

LV—0-10V WIRING (18/2 CABLE)

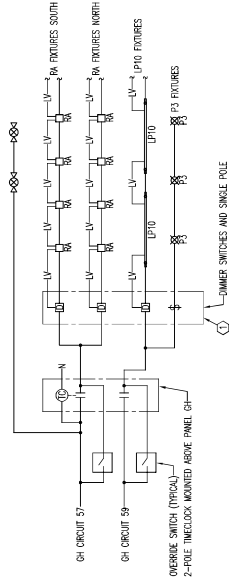

GREAT HARVEST SEATING AREA LIGHTING CONTROLS



YOGA LIGHTING CONTROLS

